



中国国家强制性产品认证证书



证书编号: 2020322313002869

认证委托人名称: CMP PRODUCTS LTD
 认证委托人地址: Unit 36 Nelson Way, Nelson Park East, Cramlington, Northumberland, NE23 1WH, United Kingdom

生产者名称: CMP PRODUCTS LTD
 生产者地址: Unit 36 Nelson Way, Nelson Park East, Cramlington, Northumberland, NE23 1WH, United Kingdom

生产企业名称: CMP PRODUCTS LTD
 企业地址: Unit 36 Nelson Way, Nelson Park East, Cramlington, Northumberland, NE23 1WH, United Kingdom

产品名称: 电缆引入装置
 系列、规格、型号: SS2K**
 标准: GB/T 3836.1-2021、GB/T 3836.2-2021、GB/T 3836.3-2021、GB/T 3836.8-2021、GB/T 3836.31-2021

认证模式: 型式试验+初始工厂检查+获证后监督

上述产品符合 CNCA-C23-01:2019 《强制性产品认证实施规则 防爆电气》的要求, 特发此证。产品相关信息详见附件。

发证日期: 2023年04月06日 有效期至: 2025年10月14日
 首次发证日期: 2020年10月15日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书的相关信息可通过国家认监委网站 www.cnca.gov.cn 查询



批准:



上海仪器仪表自控系统检验测试所有限公司



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION



CERTIFICATE NO: 2020322313002869

APPLICANT: CMP PRODUCTS LTD
ADDRESS: Unit 36 Nelson Way, Nelson Park East, Cramlington, Northumberland, NE23 1WH, United Kingdom
MANUFACTURER: CMP PRODUCTS LTD
ADDRESS: Unit 36 Nelson Way, Nelson Park East, Cramlington, Northumberland, NE23 1WH, United Kingdom
FACTORY: CMP PRODUCTS LTD
ADDRESS: Unit 36 Nelson Way, Nelson Park East, Cramlington, Northumberland, NE23 1WH, United Kingdom
PRODUCT: CABLE GLANDS
SERIES,SPECIFICATION,MODEL: SS2K**
STANDARDS: GB/T 3836.1-2021、GB/T 3836.2-2021、GB/T 3836.3-2021、GB/T 3836.8-2021、GB/T 3836.31-2021

Type of Certification: Type test + Initial inspection + Surveillance inspection

This is to certify that the above mentioned product(s)complies with the requirements of implementation rules for compulsory certification (REFNO. CNCA-C23-01:2019). Refer to the attachment for detailed information.

Valid from:April 6, 2023

Valid until:October 14, 2025

Date of original certification:October 15, 2020

The validity of this certificate is subject to positive result of the periodic surveillance by issuing certification body until the expiry date.

This certificate is available through CNCA's website: www.cnca.gov.cn



APPROVAL:

Guo AiHua



Shanghai Inspection and Testing Institute of Instruments and Automation Systems Co., Ltd.

<http://www.sitiilas.com.cn>

Building 9,103 Cao Bao Road, Shanghai 200233,China

Tel: +86 21 64510844

s 0007220



中国国家强制性产品认证证书




证书编号: 2020322313002869

附件

产品名称: 电缆引入装置

型号规格: SS2K **

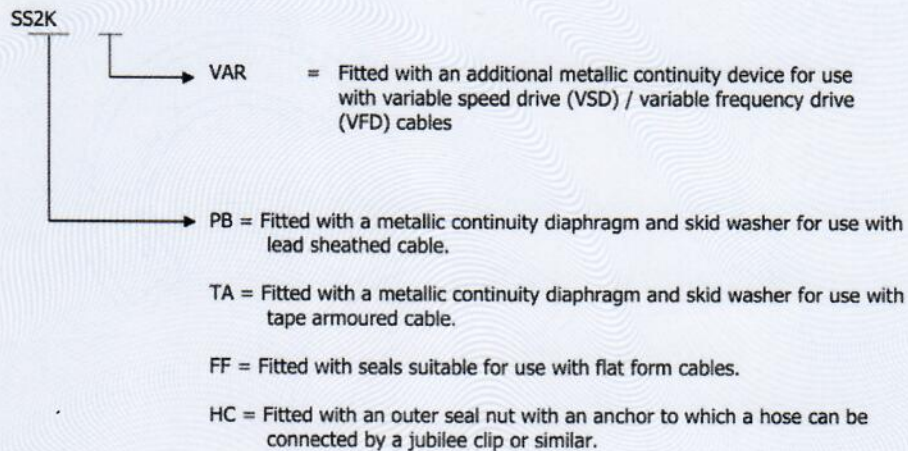

型号规格	引入口螺纹	引入口螺纹 (“B”版本)	电缆内部护套外径 (mm)		电缆外部护套外径 / 第 1 种 (mm)		电缆外部护套外径 / 第 2 种 (mm)	
			最小值	最大值	最小值	最大值	最小值	最大值
16	M16×1.5	-	3.2	8.7	3.1	8.7	6.1	13.2
20s/16	M20×1.5	M25×1.5	3.2	8.7	3.1	8.7	6.1	13.2
20s16/20s	M20×1.5	M25×1.5	3.2	8.7	6.1	11.7	9.5	15.9
20s	M20×1.5	M25×1.5	6.1	11.7	6.1	11.7	9.5	15.9
20s/20	M20×1.5	M25×1.5	6.1	11.7	6.5	14.0	12.5	20.9
20	M20×1.5	M25×1.5	6.5	14.0	6.5	14.0	12.5	20.9
20/25	M20×1.5	M25×1.5	6.5	14.0	11.1	20.0	18.2	26.2
25	M25×1.5	M32×1.5	11.1	20.0	11.1	20.0	18.2	26.2

批准:



上海仪器仪表自控系统检验测试所有限公司



中国国家强制性产品认证证书



证书编号: 2020322313002869

附 件

25/32	M25×1.5	M32×1.5	11.1	20.0	17.0	26.3	23.7	33.9
32	M32×1.5	M40×1.5	17.0	26.3	17.0	26.3	23.7	33.9
32/40	M32×1.5	M40×1.5	17.0	26.3	22.0	32.2	27.9	40.4
40	M40×1.5	M50×1.5	23.5	32.2	22.0	32.2	27.9	40.4
40/50s	M40×1.5	M50×1.5	23.5	32.2	29.5	38.2	35.2	46.7
50s	M50×1.5	M63×1.5	31.0	38.2	29.5	38.2	35.2	46.7
50s/50	M50×1.5	M63×1.5	31.0	38.2	35.6	44.1	40.4	53.1
50	M50×1.5	M63×1.5	35.6	44.1	35.6	44.1	40.4	53.1
50/63s	M50×1.5	M63×1.5	35.6	44.1	40.1	50.1	45.6	59.4
63s	M63×1.5	M75×1.5	41.5	50.0	40.1	50.1	45.6	59.4
63s/63	M63×1.5	M75×1.5	41.5	50.0	47.2	56.0	54.6	65.9
63	M63×1.5	M75×1.5	47.2	56.0	47.2	56.0	54.6	65.9
63/75s	M63×1.5	M75×1.5	47.2	56.0	52.8	62.0	59.0	72.1
75s	M75×1.5	M90×2.0	54.0	62.0	52.8	62.0	59.0	72.1
75s/75	M75×1.5	M90×2.0	54.0	62.0	59.1	68.0	66.7	78.5
75	M75×1.5	M90×2.0	61.1	68.0	59.1	68.0	66.7	78.5
75/90	M75×1.5	M90×2.0	61.1	68.0	66.6	79.4	76.2	90.4
90	M90×2.0	M100×2.0	66.6	80.0	66.6	79.4	76.2	90.4
90/100	M90×2.0	M100×2.0	66.6	80.0	76.0	91.0	86.1	101.5
100	M100×2.0	M115×2.0	76.0	91.0	76.0	91.0	86.1	101.5
100/115	M100×2.0	M115×2.0	76.0	91.0	86.0	98.0	101.5	110.3
115	M115×2.0	M130×2.0	86.0	98.0	86.0	98.0	101.5	110.3
115/130	M115×2.0	M130×2.0	86.0	98.0	97.0	115.0	110.2	123.3
130	M130×2.0	-	97.0	115.0	97.0	115.0	110.2	123.3

批 准:



上海仪器仪表自控系统检验测试所有限公司



中国国家强制性产品认证证书



证书编号：2020322313002869

附 件

仅 SS2K-FF 系列有以下规格：

型号规格	引入口螺纹	引入口螺纹 (“B” 版本)	电缆内部护套范围 (mm)		电缆外部护套范围 (mm)	
			最小值	最大值	最小值	最大值
20s	M20×1.5	M25×1.5	4.0×6.2	6.8×11.7	4.0×6.2	6.8×11.7
20	M20×1.5	M25×1.5	5.7×8.0	8.7×13.5	5.7×8.0	8.7×13.5

除以上所列螺纹规格以外，还可选用满足ANSI/ASME B1.20.1-1983第8.1条外螺纹要求的NPT螺纹。

防爆标志： Ex eb IIC Gb、Ex db IIC Gb、Ex nR IIC Gc、Ex ta IIIC Da

电气参数： /

相关报告编号： 2023S17402-011080
2020S17402-001819

使用条件： 特殊（限制）使用条件：
1、安全使用特殊条件：
1) 产品使用环境温度范围：
-60℃~+130℃（使用标准密封圈）
-20℃~+200℃（使用高温密封圈）
2) 产品配有比常规压紧元件尺寸大的入口螺纹时，压紧元件尺寸会有后缀“B”。
2、其他：产品外壳防护等级：IP66。

批 准：



上海仪器仪表自控系统检验测试所有限公司