



1 **TYPE EXAMINATION CERTIFICATE**

2 Equipment intended for use in Potentially Explosive Atmospheres Directive 94/9/EC

3 Certificate Number: **Sira 13ATEX4076X** Issue: **0**

4 Equipment: **Cable Gland Type C2K**

5 Applicant: **CMP Products Ltd**

6 Address: **Glasshouse Street  
St Peters  
Newcastle upon Tyne  
NE6 1BS  
UK**

7 This equipment and any acceptable variation thereto are specified in the schedule to this certificate and the documents therein referred to.

8 Sira Certification Service certifies that this equipment has been found to comply with the Essential Health and Safety Requirements that relate to the design of Category 3 equipment, which is intended for use in potentially explosive atmospheres. These Essential Health and Safety Requirements are given in Annex II to European Union Directive 94/9/EC of 23 March 1994.

The examination and test results are recorded in the confidential reports listed in Section 14.2.

9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the schedule of this certificate, has been assessed by reference to:

EN 60079-0:2012 EN 60079-15:2010

The above list of documents may detail standards that do not appear on the UKAS Scope of Accreditation, but have been added through Sira's flexible scope of accreditation, which is available on request.

10 If the sign "X" is placed after the certificate number, it indicates that the equipment is subject to special conditions for safe use specified in the schedule to this certificate.

11 This TYPE EXAMINATION CERTIFICATE relates only to the design of the specified equipment, and not to specific items of equipment subsequently manufactured.

12 The marking of the equipment shall include the following:



II 3G

Ex nR IIC Gc NOT CWe or CXe

Ta = -60°C to +130°C •

-20°C to +200°C ,

- When fitted with the standard seal
- , When fitted with the high temperature seal

P J Walsh  
Technical Advisor

Project Number 27765

This certificate and its schedules may only be reproduced in its entirety and without change.

**Sira Certification Service**

Rake Lane, Eccleston, Chester, CH4 9JN, England

Tel: +44 (0) 1244 670900

Fax: +44 (0) 1244 681330

Email: [info@siracertification.com](mailto:info@siracertification.com)

Web: [www.siracertification.com](http://www.siracertification.com)



## SCHEDULE

### TYPE EXAMINATION CERTIFICATE

Sira 13ATEX4076X  
Issue 0

#### 13 DESCRIPTION OF EQUIPMENT

The C\*\* series Type ranges of cable glands consist of a male-threaded front entry component, which is intended to screw into an entry point of its associated enclosure in accordance with relevant codes of practice. Clamping of the armour or braid is effected by a combination of the front entry component, main body and the different optional armour cone and armour sleeve combinations being fastened together. An outer seal nut, containing an elastomeric sealing ring and a Nylon 6 ferrule, threads onto the main body and effects environmental sealing onto the cable outer sheath

#### Design options

- The front entry component may be manufactured with a profiled groove to captivate an 'O' ring seal which locates on the mating face with the associated enclosure. This option having the gland type designation prefixed with the letter R, e.g.25RC2K

The C2K can be supplied with a cone type dedicated to SWA cable and known as the C2KW, or with a cone dedicated to braid or tape armours and known as the C2KX.

- Materials of manufacture:  
Brass to EN12168:1998 Grade CuZn39Pb (CW614N)  
Mild steel to BS EN 10088-3:2005 Grade 220M07Pb  
Stainless steel to BS EN 10088-3:2005 Grade 316S11, 316S13, 316S31 or 316S33  
Aluminium alloy not inferior to grade 6082 to EN755,1-3:1996 or LM25 to BS EN 1676:2010 (Not Group I)
- Alternative entry component thread forms:  
Metric ISO 965-1, ISO965-3 medium fit (6g) for external threads  
ET(Conduit) BS 31:1940 (1979), Table A  
PG DIN 40430:1971  
BSPP BS 2779:1973 class A full form for external threads  
BSPTBS 21:1985 standard threads only as clause 5.4, gauging to clause 5.2 system A  
ISO ISO 7/1:1982, gauging to ISO 7/2 clause 6.3 for external threads  
NPT ANSI/ASME B1.20.1-1983 gauging to clause 8.1 for external threads  
NPSMANSI/ASME B1.20.1-1983 gauging to clause 9 for external threads
- The option to manufacture glands with entry threads that are one size up from the nominal quoted gland size.
- The use of alternative armour clamping components. The various arrangements vary the cable gland suitability for differing armour or braided type cables.
- The use of a component having an alternative profile allowing an integral earthing facility. The type designation identifying the cable gland being fitted with this option.
- The use of an earthing device component specified by the cable gland type designation for use with variable speed drive (VSD) / variable frequency drive (VFD) cables.
- Alternative material of manufacture of the ferrule or skid washer to be the same as the gland material.
- Alternative outer seal arrangement to allow the glands to be attached to flexible conduit.
- The gland and seal sizes are determined by the entry thread and cable range take sizes:
- The option to fit a flat blanking disc between the outer seal and the main body to maintain a minimum IP66 rating. The disc is to be marked 'EX e only.

This certificate and its schedules may only be reproduced in its entirety and without change.

### Sira Certification Service

Rake Lane, Eccleston, Chester, CH4 9JN, England

Tel: +44 (0) 1244 670900  
Fax: +44 (0) 1244 681330  
Email: [info@siracertification.com](mailto:info@siracertification.com)  
Web: [www.siracertification.com](http://www.siracertification.com)



SCHEDULE

TYPE EXAMINATION CERTIFICATE

Sira 13ATEX4076X  
Issue 0

Gland size	Entry thread	Entry thread 'B' version	Cable inner sheath Ø (mm)	SWA (mm)		SWA, STA, strip armour, pliable wire armour* & wire braid (mm)		Outer seal sheath range Ø (mm)	
				Max.	Min.	Max.	Min.	Max.	Min.
16	M16 x 1.5	-	8.7	0.8	1.25	0	0.8	6.1	13.2
20s/16	M20 x 1.5	M25 x 1.5	8.7	0.8	1.25	0	0.8	6.1	13.2
20s	M20 x 1.5	M25 x 1.5	11.7	0.8	1.25	0	0.8	9.5	15.9
20	M20 x 1.5	M25 x 1.5	14.0	0.8	1.25	0	0.8	12.5	20.9
25s	M25 x 1.5	M32 x 1.5	20.0	1.25	1.6	0	1.1	14.0	22.0
25	M25 x 1.5	M32 x 1.5	20.0	1.25	1.6	0	1.1	18.2	26.2
32	M32 x 1.5	M40 x 1.5	26.3	1.6	2.0	0	1.2	23.7	33.9
40	M40 x 1.5	M50 x 1.5	32.2	1.6	2.0	0	1.2	27.9	40.4
50s	M50 x 1.5	M63 x 1.5	38.2	2.0	2.5	0	1.5	35.2	46.7
50	M50 x 1.5	M63 x 1.5	44.1	2.0	2.5	0	1.0	40.4	53.1
63s	M63 x 1.5	M75 x 1.5	50.0	2.0	2.5	0	1.0	45.6	59.4
63	M63 x 1.5	M75 x 1.5	56.0	2.0	2.5	0	1.0	54.6	65.9
75s	M75 x 1.5	M90 x 2.0	62.0	2.0	2.5	0	1.0	59.0	72.1
75	M75 x 1.5	M90 x 2.0	68.0	2.5	3.0	0	1.0	66.7	78.5
90	M90 x 2.0	M100 x 2.0	80.0	3.0	3.5	0	1.6	76.2	90.4
100	M100 x 2.0	M115 x 2.0	91.0	3.15	4.0	0	1.6	86.1	101.5
115	M115 x 2.0	M130 x 2.0	98.0	3.15	4.0	0	1.6	101.5	110.3
130	M130 x 2.0	N / A	115.0	3.15	4.0	0	1.6	110.2	123.3

- \* - 'Xe' and '2K' versions only

C\*-FF in these sizes only.

Gland Size	Entry Thread	Entry thread 'B' version	Cable Outer Sheath (mm)	
			Min.	Max.
20s	M20 x 1.5	M25 x 1.5	4.4 x 7.8	6.8 x 11.7
20	M20 x 1.5	M25 x 1.5	4.4 x 10.9	8.7 x 16.0

This certificate and its schedules may only be reproduced in its entirety and without change.




SCHEDULE

TYPE EXAMINATION CERTIFICATE

Sira 13ATEX4076X  
Issue 0

Type designation code

C

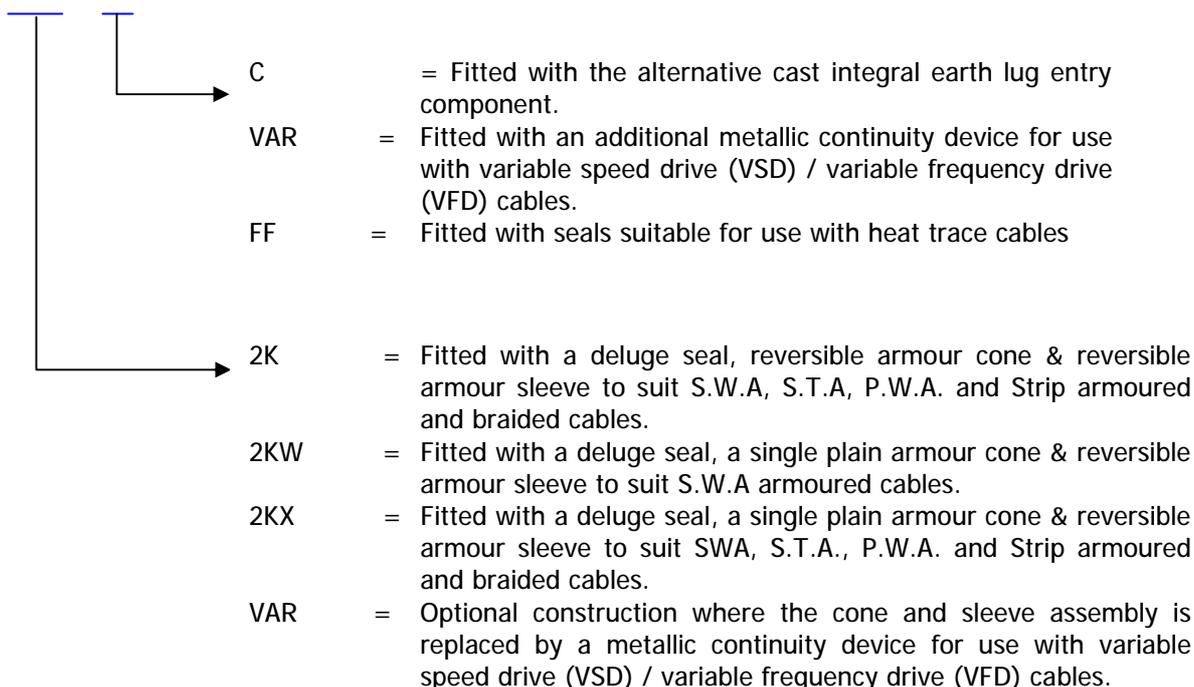

This certificate and its schedules may only be reproduced in its entirety and without change.



**SCHEDULE**

**TYPE EXAMINATION CERTIFICATE**

Sira 13ATEX4076X  
Issue 0

**14 DESCRIPTIVE DOCUMENTS**

**14.1 Drawings**

Refer to Certificate Annexe.

**14.2 Associated Sira Reports and Certificate History**

Issue	Date	Report number	Comment
0	18 April 2013	R27765A/00	The release of prime certificate.

**15 SPECIAL CONDITIONS FOR SAFE USE**

- 15.1 The glands when used for terminating braided cables are only suitable for fixed installations. Cables must be effectively clamped to prevent pulling or twisting.
- 15.2 When the cable glands are supplied with an entry thread that is one size up from the nominal gland size, designated with the letter 'B' after the gland size, e.g. 32B\*\*\*\*, they shall not be used with any adaptor device.
- 15.3 When assembled for fitting to flexible conduit, the conduit shall be effectively clamped to prevent twisting and pulling.

**16 ESSENTIAL HEALTH AND SAFETY REQUIREMENTS (EHSRs)**

The relevant EHSRs that are not addressed by the standards listed in this certificate have been identified and individually assessed reports listed in Section 14.2.

**17 CONDITIONS OF CERTIFICATION**

- 17.1 The use of this certificate is subject to the Regulations Applicable to Holders of Sira Certificates.
- 17.2 Holders of Type Examination Certificates are required to comply with the production control requirements defined in Article 8 of directive 94/9/EC.

# Certificate Annexe

Certificate Number: Sira 13ATEX4076X  
Equipment: Cable Gland Type C2K  
Applicant: CMP Products Ltd

---



## Issue 0

Drawing	Sheets	Rev.	Date (Sira Stamp)	Title
GA351	1 of 1	00	13 Mar 13	C2K General arrangement & marking
SCH0322	1 of 1	00	13 Mar 13	Outer seal details
SCH0323	1 of 1	00	13 Mar 13	Armour clamp details
SCH0324	1 of 1	00	13 Mar 13	C2K Armour clamp details

This certificate and its schedules may only be reproduced in its entirety and without change.