



1 **TYPE EXAMINATION CERTIFICATE**

2 Equipment intended for use in Potentially Explosive Atmospheres Directive 94/9/EC

3 Certificate Number: **Sira 13ATEX4075X** Issue: **0**

4 Equipment: **Cable Gland Types SS2K\*\***

5 Applicant: **CMP Products Ltd**

6 Address: **Glasshouse Street  
St Peters  
Newcastle upon Tyne  
NE6 1BS  
UK**

7 This equipment and any acceptable variation thereto are specified in the schedule to this certificate and the documents therein referred to.

8 Sira Certification Service certifies that this equipment has been found to comply with the Essential Health and Safety Requirements that relate to the design of Category 3 equipment, which is intended for use in potentially explosive atmospheres. These Essential Health and Safety Requirements are given in Annex II to European Union Directive 94/9/EC of 23 March 1994.

The examination and test results are recorded in the confidential reports listed in Section 14.2.

9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the schedule of this certificate, has been assessed by reference to:

EN 60079-0:2012 EN 60079-15:2010

The above list of documents may detail standards that do not appear on the UKAS Scope of Accreditation, but have been added through Sira's flexible scope of accreditation, which is available on request.

10 If the sign "X" is placed after the certificate number, it indicates that the equipment is subject to special conditions for safe use specified in the schedule to this certificate.

11 This TYPE EXAMINATION CERTIFICATE relates only to the design of the specified equipment, and not to specific items of equipment subsequently manufactured.

12 The marking of the equipment shall include the following:



II 3G

Ex nR IIC Gc

Ta = -60°C to +130°C •

-20°C to +200°C ,

- When fitted with the standard seal
- , When fitted with the high temperature seal

P J Walsh  
Technical Advisor

Project Number 27765

This certificate and its schedules may only be reproduced in its entirety and without change.



## SCHEDULE

### TYPE EXAMINATION CERTIFICATE

Sira 13ATEX4075X  
Issue 0

#### 13 DESCRIPTION OF EQUIPMENT

##### Type designation SS2K Range

The SS2K range of cable glands are intended to terminate circular braided or unarmoured cables into enclosures without compromising the explosion protection provided by the enclosures in accordance with relevant codes of practice. They consist of a male-threaded front entry component, a main body component and an outer seal actuation nut. The front entry component, fitted with an elastomeric sealing ring and a Nylon 6 skid washer, is intended to screw into an entry point of its associated enclosure. The main body component, fitted with a locking ring, threads into the front entry component thereby effecting flameproof and environmental sealing onto the cable inner sheath. The outer seal actuation nut, fitted with an elastomeric sealing ring and a Nylon 6 skid washer, threads into the main body component thereby effecting environmental sealing onto the cable outer sheath. Two versions of the outer seal nut are available to allow alternative sizes of outer sheath to be gripped.

##### Type designation SS2K/PB Range

The SS2K/PB range of cable glands is the same as the SS2K range but the front entry component is fitted with an electrical continuity device for use with lead sheathed cable.

##### Type designation SS2K/TA Range

The SS2K/TA range of cable glands is identical to the SS2K/PB range but is used to terminate circular cables with a tape armour sheath. It is for use in Ex e applications only.

##### Type designation SS2K-FF

The SS2K-FF range of cable glands is the same as the SS2K range, but it is fitted with seals suited for use with flat form cables.

##### Design options

- The front entry component may be manufactured with a profiled groove to captivate an 'O' ring seal which locates on the mating face with the associated enclosure. This option having the gland type designation prefixed with the letter R, e.g. 25RSS2K
- Materials of manufacture:
  - Brass to EN12168:1998 Grade CuZn39Pb (CW614N)
  - Mild steel to BS EN 10088-3:2005 Grade 220M07Pb
  - Stainless steel to BS EN 10088-3:2005 Grade 316S11, 316S13, 316S31 or 316S33
  - Aluminium alloy not inferior to grade 6082 to EN755,1-3:1996 or LM25 to BS EN 1676:2010 (Not Group I)
- Alternative entry component thread forms:
  - Metric ISO 965-1, ISO965-3 medium fit (6g) for external threads
  - ET(Conduit) BS 31:1940 (1979), Table A
  - PG DIN 40430:1971
  - BSPP BS 2779:1973 class A full form for external threads
  - BSPTBS 21:1985 standard threads only as clause 5.4, gauging to clause 5.2 system A
  - ISOISO 7/1:1982, gauging to ISO 7/2 clause 6.3 for external threads
  - NPTANSI/ASME B1.20.1-1983 gauging to clause 8.1 for external threads
  - NPSMANSI/ASME B1.20.1-1983 gauging to clause 9 for external threads

This certificate and its schedules may only be reproduced in its entirety and without change.

### Sira Certification Service

Rake Lane, Eccleston, Chester, CH4 9JN, England

Tel: +44 (0) 1244 670900  
Fax: +44 (0) 1244 681330  
Email: [info@siracertification.com](mailto:info@siracertification.com)  
Web: [www.siracertification.com](http://www.siracertification.com)



SCHEDULE


TYPE EXAMINATION CERTIFICATE

Sira 13ATEX4075X  
Issue 0

- The option to manufacture glands with entry threads that are one size up from the nominal quoted gland size.
- Alternative material of manufacture of the skid washer to be the same as the gland material.
- The front entry component may additionally be fitted with a metallic continuity diaphragm and skid washer for use with lead sheathed cable.
- The main body component may additionally be fitted with an electrical continuity device for use with variable speed drive (VSD) / variable frequency drive (VFD) cables.
- The option to fit a flat blanking disc between the outer seal and the main body to maintain an minimum IP66 ingress protection. The disc to be marked 'Exe only' to indicate that the gland is not suitable for use in Ex d applications when it is fitted.
- An optional outer seal nut with an anchor to which hose can be connected by a jubilee clip or similar

Type designation code

SS2K

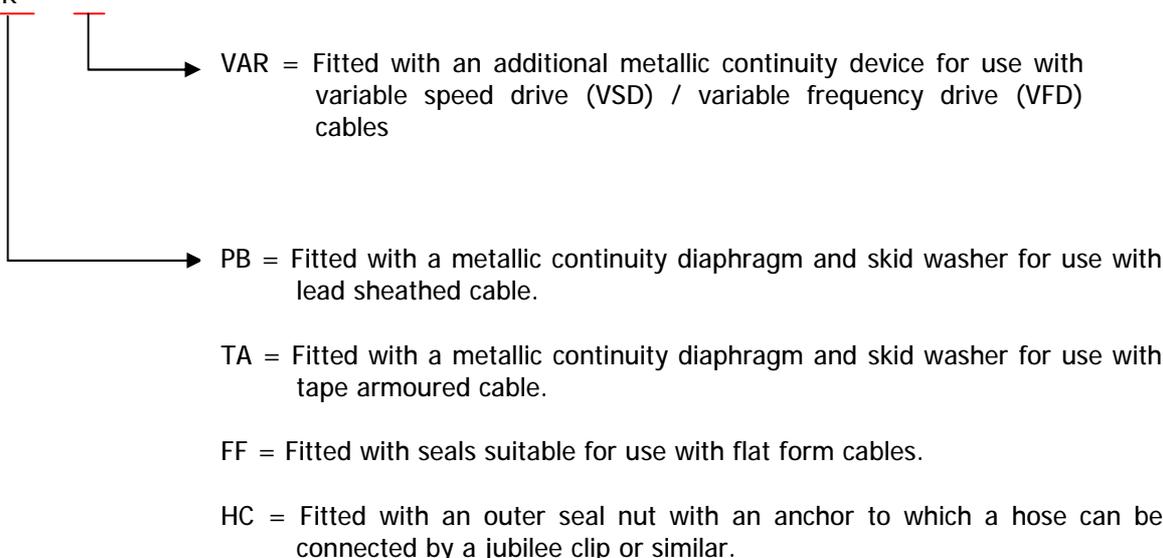

The gland and seal sizes are determined by the entry thread and cable range take sizes:

Gland size	Entry thread	Entry thread 'B' version	Cable inner seal sheath range Ø (mm)		Cable outer seal sheath range Ø (mm)		Alternative outer seal sheath range Ø (mm)	
			Min.	Max.	Min.	Max.	Min.	Max.
16	M16 x 1.5	-	3.2	8.7	3.1	8.7	6.1	13.2
20s/16	M20 x 1.5	M25 x 1.5	3.2	8.7	3.1	8.7	6.1	13.2
20s16/20s	M20 x 1.5	M25 x 1.5	3.2	8.7	6.1	11.7	9.5	15.9
20s	M20 x 1.5	M25 x 1.5	6.1	11.7	6.1	11.7	9.5	15.9
20s/20	M20 x 1.5	M25 x 1.5	6.1	11.7	6.5	14.0	12.5	20.9
20	M20 x 1.5	M25 x 1.5	6.5	14.0	6.5	14.0	12.5	20.9
20/25	M20 x 1.5	M25 x 1.5	6.5	14.0	11.1	20.0	18.2	26.2

This certificate and its schedules may only be reproduced in its entirety and without change.

**Sira Certification Service**

Rake Lane, Eccleston, Chester, CH4 9JN, England

Tel: +44 (0) 1244 670900  
 Fax: +44 (0) 1244 681330  
 Email: [info@siracertification.com](mailto:info@siracertification.com)  
 Web: [www.siracertification.com](http://www.siracertification.com)



SCHEDULE

TYPE EXAMINATION CERTIFICATE

Sira 13ATEX4075X  
Issue 0

Gland size	Entry thread	Entry thread 'B' version	Cable inner seal sheath range Ø (mm)		Cable outer seal sheath range Ø (mm)		Alternative outer seal sheath range Ø (mm)	
			Min.	Max.	Min.	Max.	Min.	Max.
25	M25 x 1.5	M32 x 1.5	11.1	20.0	11.1	20.0	18.2	26.2
25/32	M25 x 1.5	M32 x 1.5	11.1	20.0	17.0	26.3	23.7	33.9
32	M32 x 1.5	M40 x 1.5	17.0	26.3	17.0	26.3	23.7	33.9
32/40	M32 x 1.5	M40 x 1.5	17.0	26.3	22.0	32.2	27.9	40.4
40	M40 x 1.5	M50 x 1.5	23.5	32.2	22.0	32.2	27.9	40.4
40/50s	M40 x 1.5	M50 x 1.5	23.5	32.2	29.5	38.2	35.2	46.7
50s	M50 x 1.5	M63 x 1.5	31.0	38.2	29.5	38.2	35.2	46.7
50s/50	M50 x 1.5	M63 x 1.5	31.0	38.2	35.6	44.1	40.4	53.1
50	M50 x 1.5	M63 x 1.5	35.6	44.1	35.6	44.1	40.4	53.1
50/63s	M50 x 1.5	M63 x 1.5	35.6	44.1	40.1	50.1	45.6	59.4
63s	M63 x 1.5	M75 x 1.5	41.5	50.0	40.1	50.1	45.6	59.4
63s/63	M63 x 1.5	M75 x 1.5	41.5	50.0	47.2	56.0	54.6	65.9
63	M63 x 1.5	M75 x 1.5	47.2	56.0	47.2	56.0	54.6	65.9
63/75s	M63 x 1.5	M75 x 1.5	47.2	56.0	52.8	62.0	59.0	72.1
75s	M75 x 1.5	M90 x 2.0	54.0	62.0	52.8	62.0	59.0	72.1
75s/75	M75 x 1.5	M90 x 2.0	54.0	62.0	59.1	68.0	66.7	78.5
75	M75 x 1.5	M90 x 2.0	61.1	68.0	59.1	68.0	66.7	78.5
75/90	M75 x 1.5	M90 x 2.0	61.1	68.0	66.6	79.4	76.2	90.4
90	M90 x 2.0	M100 x 2.0	66.6	80.0	66.6	79.4	76.2	90.4
90/100	M90 x 2.0	M100 x 2.0	66.6	80.0	76.0	91.0	86.1	101.5
100	M100 x 2.0	M115 x 2.0	76.0	91.0	76.0	91.0	86.1	101.5
100/115	M100 x 2.0	M115 x 2.0	76.0	91.0	86.0	98.0	101.5	110.3
115	M115 x 2.0	M130 x 2.0	86.0	98.0	86.0	98.0	101.5	110.3
115/130	M115 x 2.0	M130 x 2.0	86.0	98.0	97.0	115.0	110.2	123.3
130	M130 x 2.0	Not available	97.0	115.0	97.0	115.0	110.2	123.3

Cable sizes for the SS2K-FF range only

Gland size	Entry thread	Entry thread 'B' version	Cable inner seal sheath range (mm)		Cable outer seal sheath range (mm)	
			Min.	Max.	Min.	Max.
20s	M20 x 1.5	M25 x 1.5	4.0 x 6.2	6.8 x 11.7	4.4 x 7.8	6.8 x 11.7
20	M20 x 1.5	M25 x 1.5	5.7 x 8.0	8.7 x 13.5	5.7 x 8.0	8.7 x 13.5

14 DESCRIPTIVE DOCUMENTS

14.1 Drawings

Refer to Certificate Annexe.

14.2 Associated Sira Reports and Certificate History

Issue	Date	Report number	Comment
0	29 April 2013	R27765A/00	The release of prime certificate.

This certificate and its schedules may only be reproduced in its entirety and without change.

**Sira Certification Service**

Rake Lane, Eccleston, Chester, CH4 9JN, England

Tel: +44 (0) 1244 670900  
 Fax: +44 (0) 1244 681330  
 Email: [info@siracertification.com](mailto:info@siracertification.com)  
 Web: [www.siracertification.com](http://www.siracertification.com)



**SCHEDULE**

**TYPE EXAMINATION CERTIFICATE**

Sira 13ATEX4075X  
Issue 0

**15 SPECIAL CONDITIONS FOR SAFE USE**

15.1 When the cable glands are supplied with an entry thread that is one size up from the nominal gland size, designated with the letter 'B' after the gland size, e.g. 32B\*\*\*\*, they shall not be used with any adaptor device.

**16 ESSENTIAL HEALTH AND SAFETY REQUIREMENTS (EHSRs)**

The relevant EHSRs that are not addressed by the standards listed in this certificate have been identified and individually assessed reports listed in Section 14.2.

**17 CONDITIONS OF CERTIFICATION**

17.1 The use of this certificate is subject to the Regulations Applicable to Holders of Sira Certificates.

17.2 Holders of Type Examination Certificates are required to comply with the production control requirements defined in Article 8 of directive 94/9/EC.

# Certificate Annexe

Certificate Number: Sira 13ATEX4075X  
Equipment: Cable Gland Types SS2K\*\*  
Applicant: CMP Products Ltd

---



## Issue 0

Drawing	Sheets	Rev.	Date (Sira Stamp)	Title
GA184	1 of 1	09	29 Apr 13	SS2K General arrangement & marking
SCH0321	1 of 1	00	13 Mar 13	Inner seal details
SCH0326	1 of 1	00	13 Mar 13	SS2K outer seal details

This certificate and its schedules may only be reproduced in its entirety and without change.